



AH2-2585

To avoid the leakage caused by peak pressure, an Anti-Explosion Valve or By-Pass Valve should be always mounted. Off-Line Circuit is strongly recommended. Pumping the oil from the tank to the heat exchanger with a separated cooling pump. Please refer to 《Installation & Maintenance》 for more.

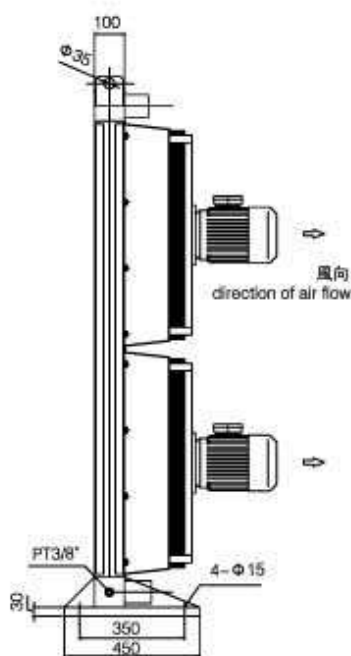

Part No.	Flow Rate	Standard Voltage	Frequency	Power	Current	Rotation Speed	Air Flow	IP Level	Noise	Certification
AH2-2585-CA	L/min	V	Hz	W	A	R. P. M	m³/h	IP	dB (A)	
	100-350	3P 210-230/360-400	50	3Kw	12. 3-12. 5/5. 12-5. 76	1400	10000	55		CE
		3P 240-270/420-480	60	3. 44Kw	12. 3-12. 5/5. 12-5. 76	1680	12000	55		CE

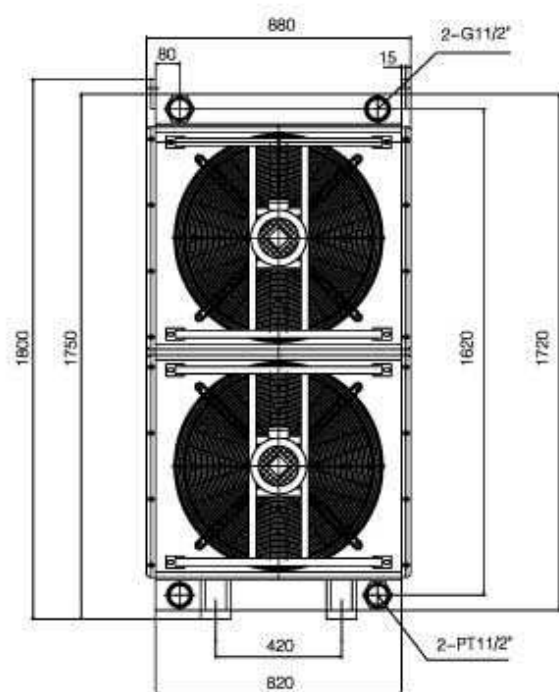